

SL-24 Series Stacklights

Wiring Instructions

These stacklight modules are twist-lock assembled. Remove the bottom base module and unsnap the wire terminal to access it.

"C" terminal is Common to all connected modules.

Numbers 1 through 5 refer to the modules, in order from the base to the top.

C = Common (Power supply ground)


1 = +24VDC for first module

2 = +24VDC for second module

3 = +24VDC for third module

4 = +24VDC for fourth module

5 = +24VDC for fifth module

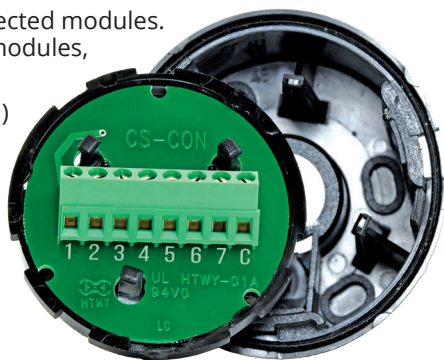

Mounting Instructions

Two mounting adaptors are included with each base.

For panel-mount installation: Use the black anodized fitting.

1. Slide the unthreaded end securely into the bottom of the base module.
2. Tighten the binding screw on the inside of the base to secure it in place.
3. The two included nuts can then be used to hold stacklight in place on a panel or conduit box.



For pole-mount installation: Use the compression fitting.

1. Screw the 1/2" NPT threads of the compression fitting firmly into the bottom of the base module. The base is not threaded but the fitting will "cut" threads, holding it firmly in place. A watertight seal can be made with the use of a silicone adhesive or other sealant.
2. The assembled unit can now be installed onto 1/2" EMT conduit.



For additional help with this product, call CTI at 866-394-5861 during normal business hours.